

STONCLAD UF WITH NO PRIMER – CAREFUL CONSIDERATION OF THE SUBSTRATE

Ref # Date

REQUIREMENTS:

Proposed polyurethane screed system where a heavy-duty, non-slip, self-priming, 6 to 9mm industrial floor coating system is required with no topcoat, exposed to heavy traffic, thermal shock, occasional impact and wet conditions (project name and location).

SCOPE OF WORK (BOQ):

Apply **Stonclad UF** at 6 to 9mm as per the engineering requirements as a heavy-duty floor screed. Apply **Stonclad UF** in strict accordance with the manufacturer's product data sheet, finished off with a textured, non-slip or smooth finish as required.

THE STONCLAD HF SYSTEM CONSISTS OF:

	Product	Kit Size	Theoretical Coverage
Flooring System	Stonclad UT Base, Stonclad UF Activator, Stonclad UF Aggregate and Stonclad UT Pigment Pack	14 Litre kit	2.33m ² /kit at 6mm 1.55m ² /kit at 9mm

NOTE:

If **Stonclad UF** is selected as a self-priming solution, specific notes to be provided during selection process.

TEMPERATURE:

Do not attempt to install this material unless the application team is fully trained and understands the requirements of working with materials with short application times within the specified temperature range. Substrate and material temperature are to be within 16°C to 30°C.

SUBSTRATE PREPARATION:

Stonclad UF can be applied over properly prepared concrete surfaces which are even and do not require renovation. The substrate must be dry and free of all wax, grease, oils, fats, loose or foreign material and laitance. Laitance and unbonded cement particles must be removed by mechanical methods, i.e. abrasive blasting or scarifying. The surface must show open pores throughout and with main aggregate in concrete exposed and have a coarse sandpaper texture. Retaining slots, 6mm x 6mm, must be cut running 75mm from and parallel to the walls, edges and both sides of joints. If weak, friable substrates exist, it should be removed and repaired with the appropriate Euclid repair material. Product can be laid on 1 to 2 week old concrete, provided a minimum tensile strength of 2.0 MPa has been achieved. For recommendations or additional information regarding substrate preparation, please consult StonCor Africa's "Surface Preparation Methods".

PRIMING:

Not normally required. Certain substrates may require priming, see notes above.

The Applicator contracts with the Client to apply the coating system strictly in accordance with the specification, and is therefore required to monitor the quality of his own workmanship. Any deviations from the specification are for agreement between the Applicator and the Client. StonCor Africa acts in an advisory capacity only, to provide technical assistance to other parties, and does not inspect nor approve the quality of application and workmanship.

REFER TO THE LATEST PRODUCT DATA SHEETS BEFORE PRICING OR COMMENCING APPLICATION, FOR ADDITIONAL INFORMATION AND CAUTIONS CONCERNING PRODUCT USAGE.

StonCor Africa (Pty) Ltd
Co. Reg. No.: 1996/01848/07
Tel No: +27 11 254 5500
Website: www.stoncor.co.za
E-mail: stoncorsa@stoncor.com

MIXING:

Mixing station must be set up to deliver a kit of material to the applicators every 3 minutes. A well displayed clock is necessary to ensure consistent supply and mixing times. Remove all lids from resin components and open pigment packs and aggregate bags. Two 25 litre clean dry mixing drums must be available. Spiral impellers fitted to a high torque, variable speed 600 rpm mixer should be used for thorough mixing.

Empty the entire contents of the Part B and Part A components into the 25 litre container. Mix mechanically for 30 seconds, then add the pigment pack, continue mixing for a further 30 seconds. Pour in the HF aggregate and mix for another 90 seconds. Immediately send the mixed material to the application floor area and within 30 seconds start another mix in the second 25 litre container. Every 3 minutes a new batch should be made.

APPLICATION:

- The use of screeding rails is recommended during application to ensure even spread and levelling is achieved.
- Divide the floor into panels not greater than 5m wide. This will ensure that fresh product is applied onto the wet edge of the previous kit.
- Apply one kit of **Stonclad UF** by pouring the mixture in a line onto the floor and raking out using a 15mm notched trowel, or screeding rails with a straight edge, spreading evenly at specified thickness. This application should not take longer than 2 minutes.
- Level out the material to an even finish by floating with a flat plastic trowel.
- If a less textured finish is required, lightly roll the trowelled surface with a loop roller. This process is carried out immediately behind the applicator trowelling the material level, whilst still wet and fresh.
- Do not re-roll material after 6 minutes of application.
- Allow to cure for 12 hours at 25°C before re-cutting joints and sealing.

COLOUR UNIFORMITY:

Erratic periods of mixing and variable times of solvent rolling will lead to an uneven colour and non-uniform appearance. The use of a well displayed clock and fully trained staff is essential.

CURING:

If temperatures are between 16 to 30°C, the flooring system can be exposed to light traffic after 24 hours. Excessive traffic, aqueous cleaning and exposure to aggressive chemicals should only take place after 4 to 5 days, when full cure has been achieved.

JOINTS:

Remove nails and re-cut joints as to reflect the substrate joints. Install suitable joint sealant or joint filler as required by the specification.

NOTE:

Do not attempt to install this material unless application team is fully trained and understands the requirements of working with materials with short application times within the specified temperature range. Substrate and material temperature are to be within 16°C to 30°C.

The Applicator contracts with the Client to apply the coating system strictly in accordance with the specification, and is therefore required to monitor the quality of his own workmanship. Any deviations from the specification are for agreement between the Applicator and the Client. StonCor Africa acts in an advisory capacity only, to provide technical assistance to other parties, and does not inspect nor approve the quality of application and workmanship.


REFER TO THE LATEST PRODUCT DATA SHEETS BEFORE PRICING OR COMMENCING APPLICATION, FOR ADDITIONAL INFORMATION AND CAUTIONS CONCERNING PRODUCT USAGE.

StonCor Africa (Pty) Ltd
Co. Reg. No.: 1996/01848/07
Tel No: +27 11 254 5500
Website: www.stoncor.co.za
E-mail: stoncorsa@stoncor.com

ARCHITECT DETAIL:

- Coving
- Joints

COVING:

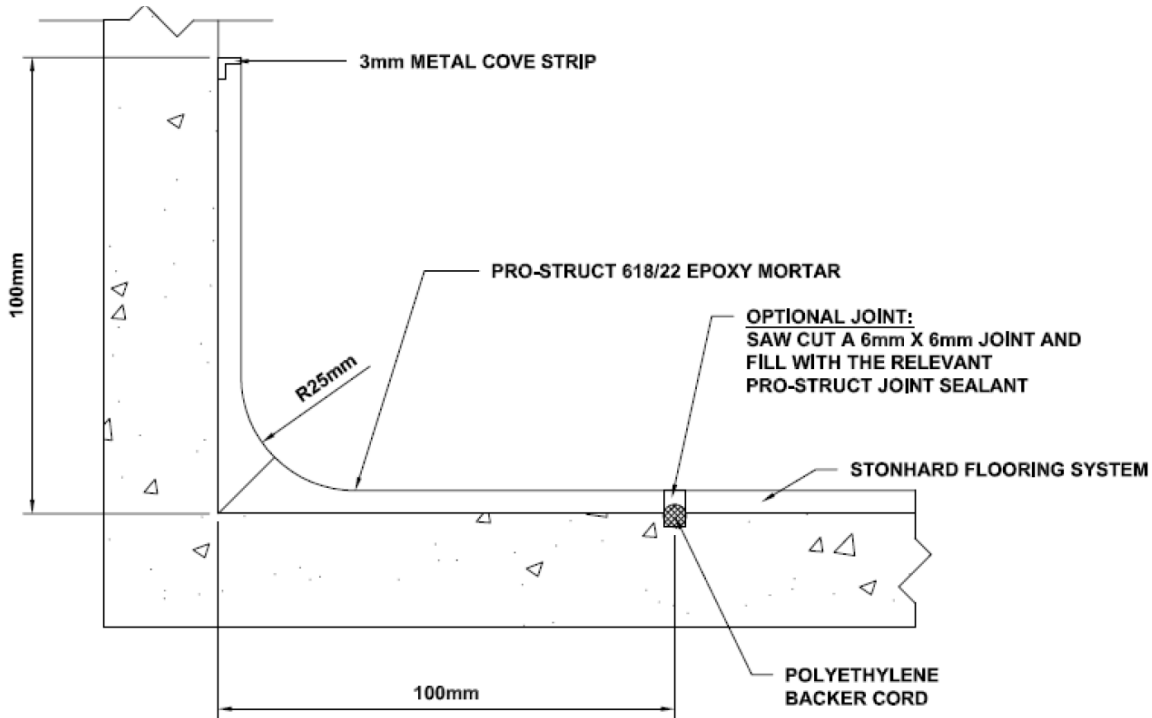

APPLICATION PROCEDURE FOR EPOXY MORTAR COVERED SKIRTINGS:

- Epoxy mortar coved skirtings shall be installed prior to the installation of the flooring system.
- Install the metal cove strip to the wall to the desired height using contact adhesive, taking care to mask above the cove strip for neatness.
- Prime the prepared plastered / concrete surfaces with **Dural 618R** at a theoretical coverage of 15 linear metres x 200mm wide per 1 litre kit and broadcast **Stonhard 6222** Aggregate into the wet resin. Allow 6 to 8 hours to cure at 25°C.
- Mix the 1 litre kits of base and activator of **Dural 618/22** for 2 minutes using a JB blender. Add the 6kg bag of **Stonhard 622** aggregate and mix for a further 2 minutes. The yield of this kit is 3,64 litres. Using a steel trowel, apply the **Dural 618/22** Mortar to the primed concrete and plastered surfaces to a theoretical spreading rate of 3,6 linear metres for a 100mm x 100mm x 25mm radius.
- Form the cove to the desired radius using a suitable coving trowel, allow to cure for 18 to 24 hours at 25°C.
- Abrade the vertical surface of the cove to remove surface imperfections.
- Overcoat the coving with the proposed flooring sealer.

Technical Approval: _____

Date: _____

The Applicator contracts with the Client to apply the coating system strictly in accordance with the specification, and is therefore required to monitor the quality of his own workmanship. Any deviations from the specification are for agreement between the Applicator and the Client. StonCor Africa acts in an advisory capacity only, to provide technical assistance to other parties, and does not inspect nor approve the quality of application and workmanship.

REFER TO THE LATEST PRODUCT DATA SHEETS BEFORE PRICING OR COMMENCING APPLICATION, FOR ADDITIONAL INFORMATION AND CAUTIONS CONCERNING PRODUCT USAGE.

StonCor Africa (Pty) Ltd
Co. Reg. No.: 1996/01848/07
Tel No: +27 11 254 5500
Website: www.stoncor.co.za
E-mail: stoncorsa@stoncor.com